
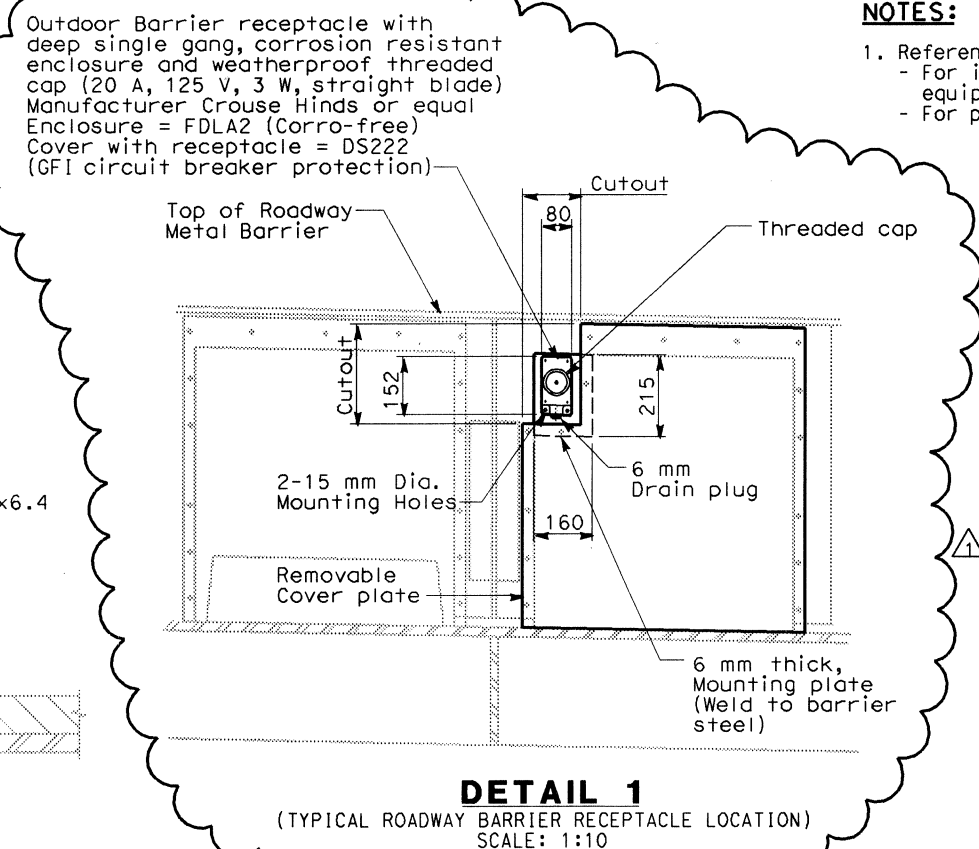
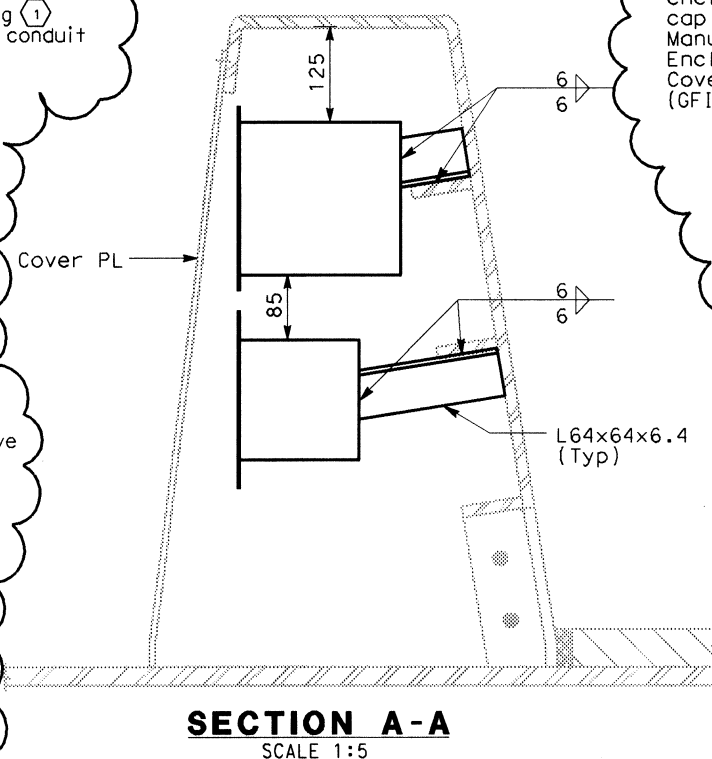


SHEET NOTES:

-
- 1 Bond grounding bushing to ground lug of lighting pole with #6 bare copper wire.
- 2 Deleted
- 3 Conduit penetration thru girder plate and lighting pole metal base, see Utility Detail No. 1 of Superstructure and Tower Drawings. To prevent moisture from passing inside the sleeve, the Contractor shall install sealant between the sleeve and conduit.

NOTES:

1. References:
- For installation and typical details of TOS equipment, see sheets E-341 thru E-357.
 - For pull box schedule, see sheet E-169

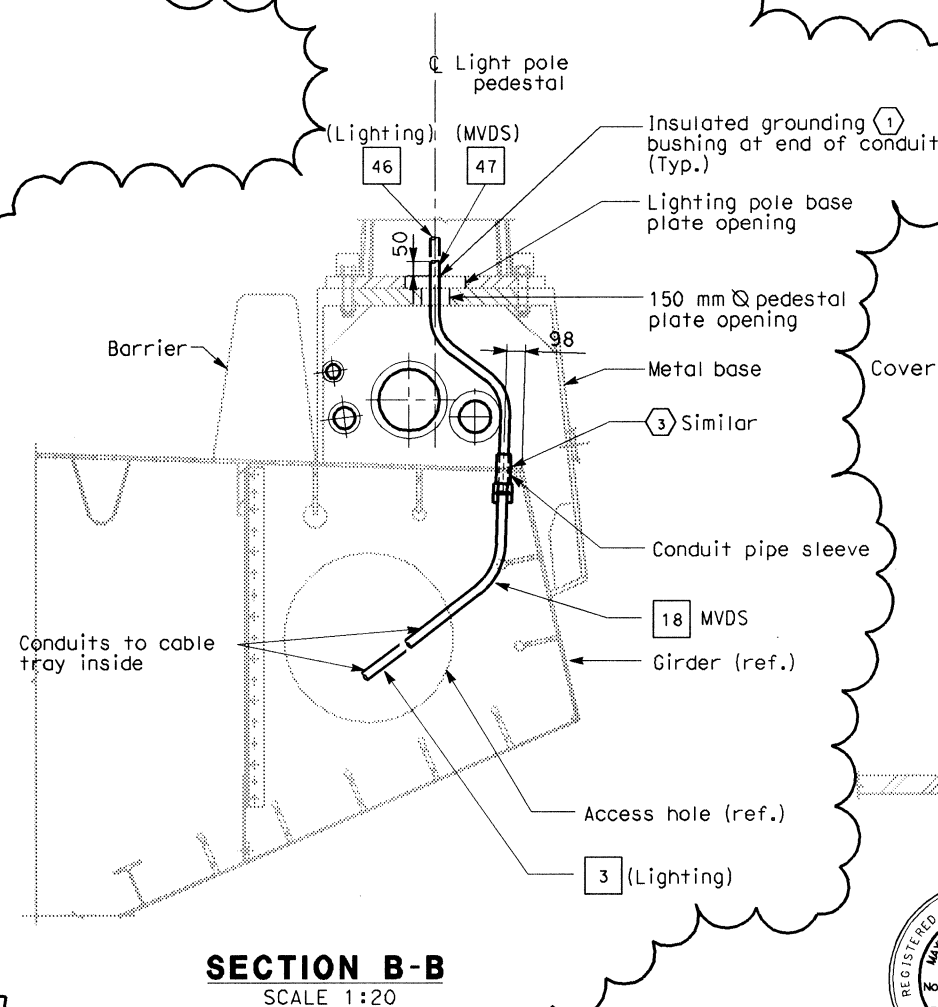

REQUEST FOR INFORMATION NOT ADDRESSED IN THIS CCO REMAIN IN FORCE					
MARK	DATE	DESCRIPTIONS REVISIONS	MP EL RG	RR	42
1	02/19/08	ELECTRICAL MODIFICATIONS			

CONTRACT CHANGE ORDER NO. _____
SHEET OF

DETAILS
SAS SUPERSTRUCTURE ROADWAY EASTBOUND
CONDUIT LOCATIONS
SCALE AS NOTED

E-162